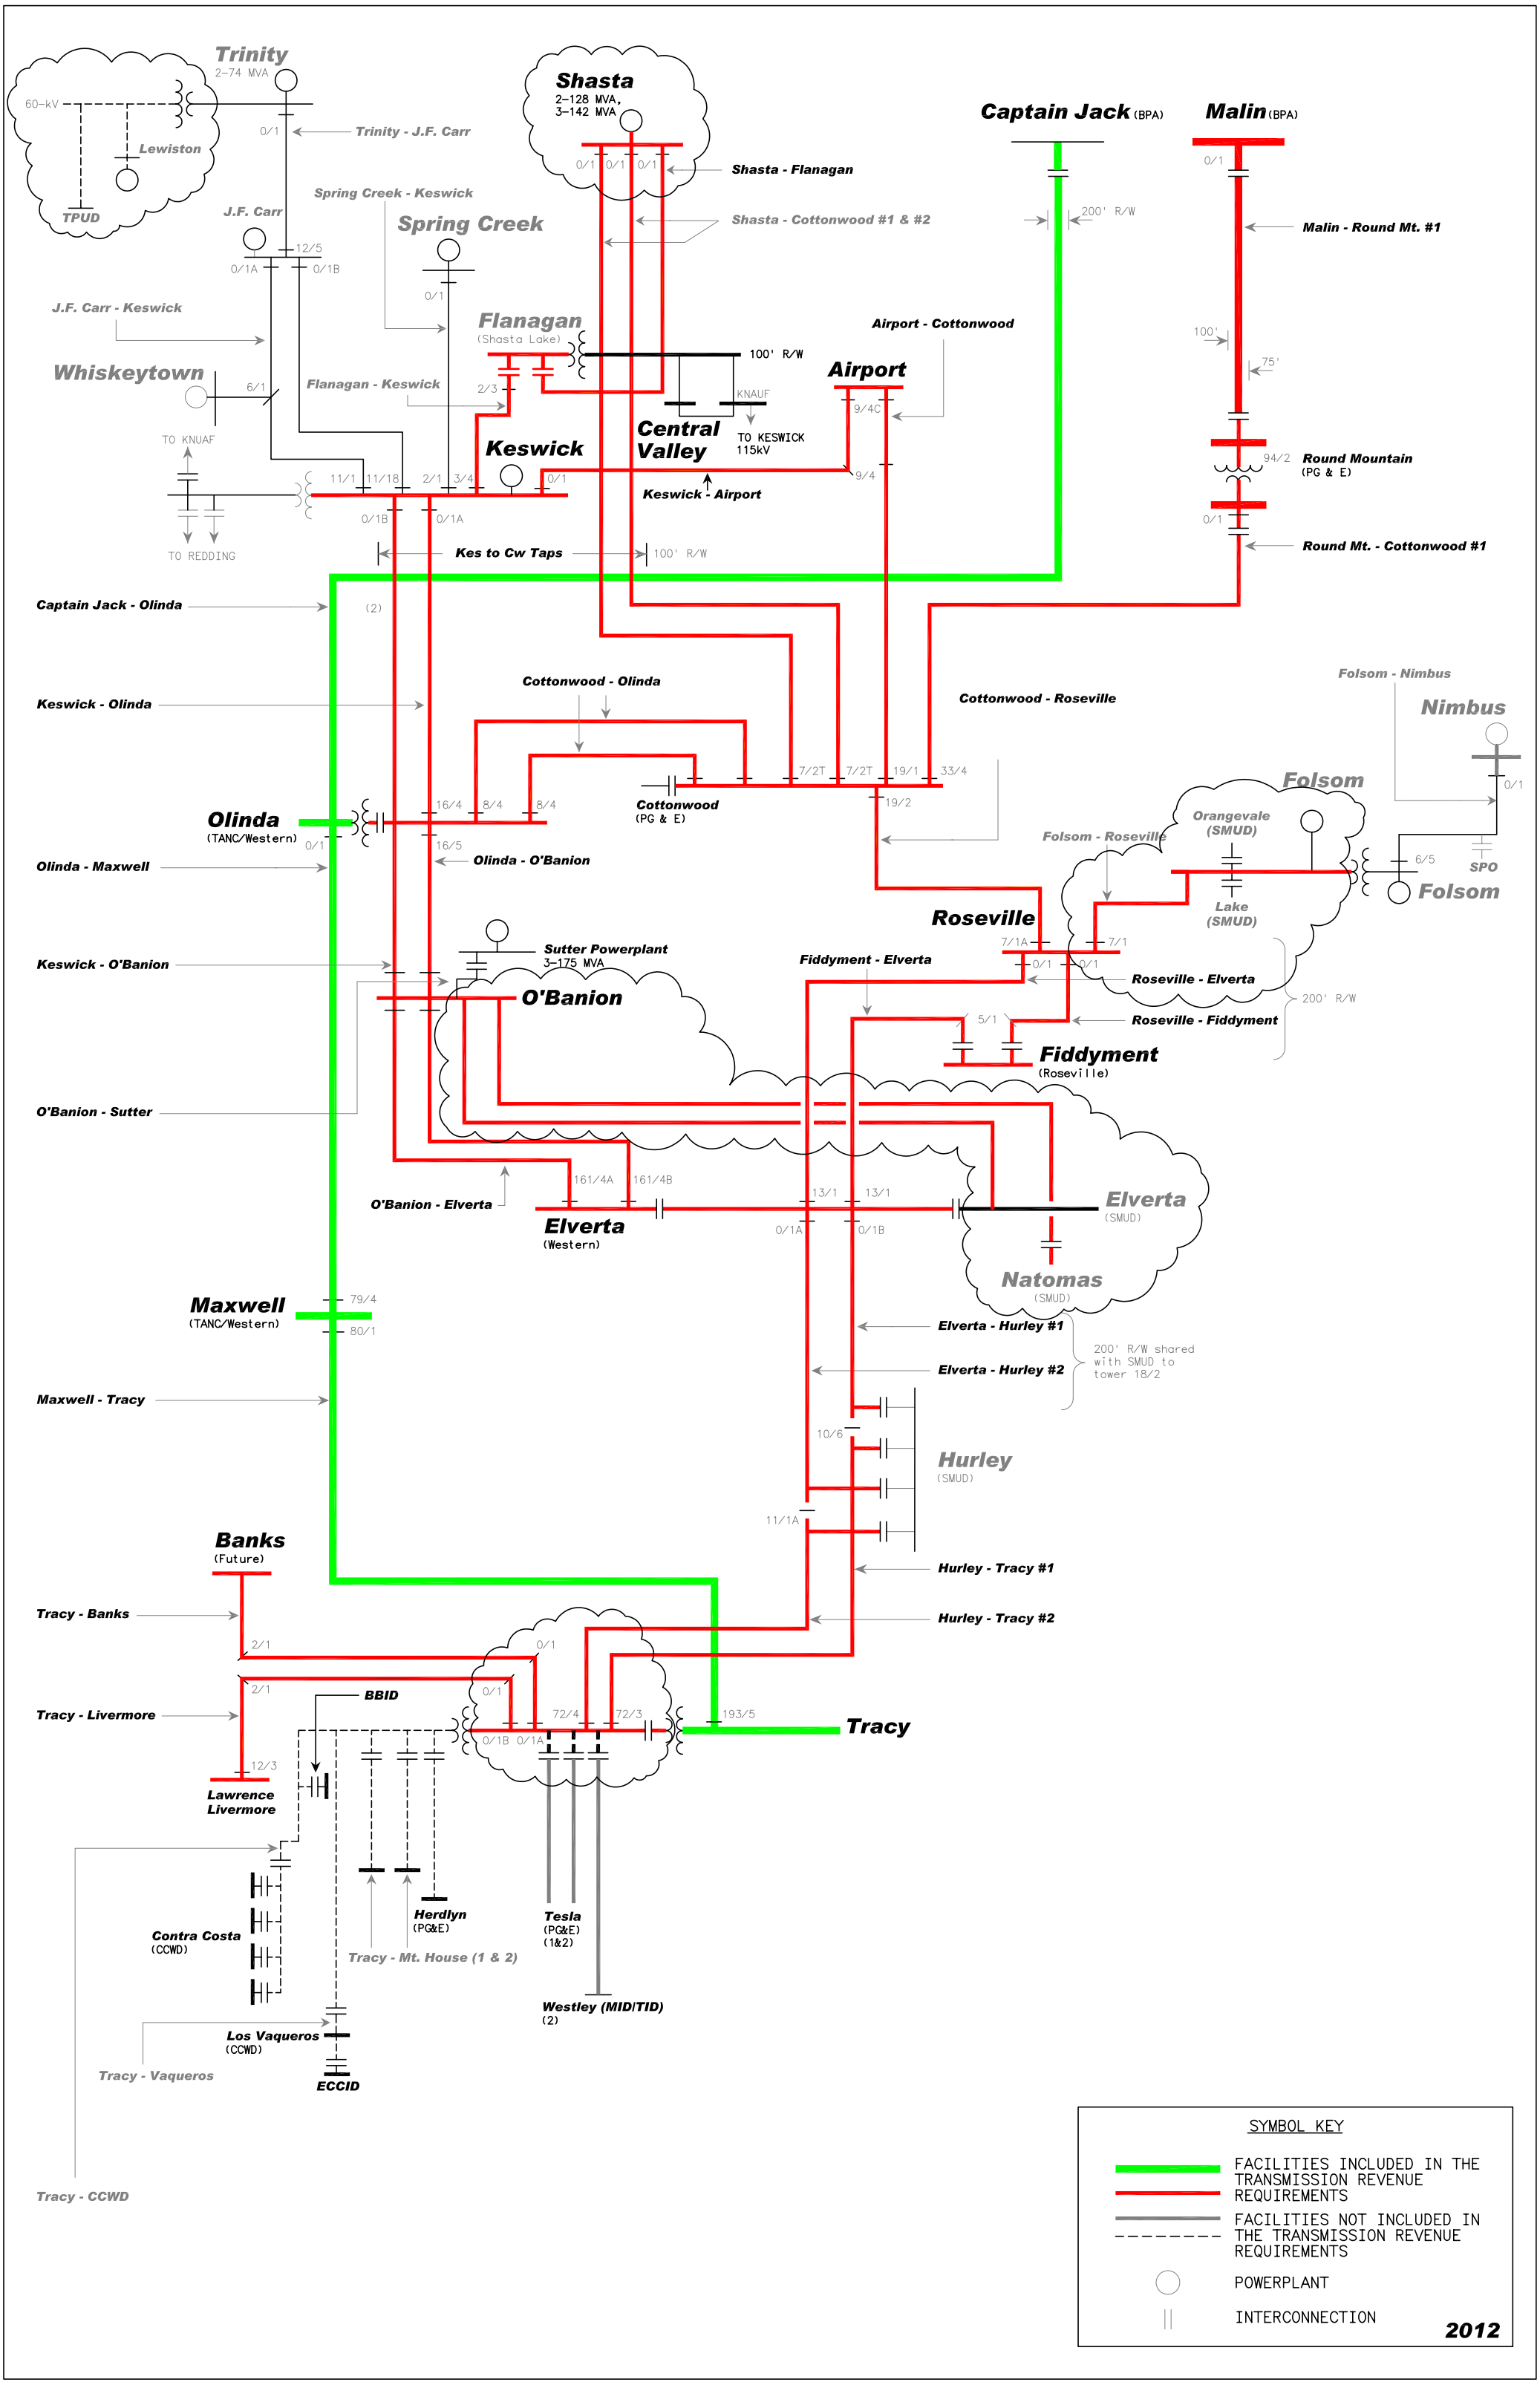
Trinity
2-74 MVA
60-kV
Lewiston
TPUD
Trinity - J.F. Carr
Shasta
2-128 MVA,
3-142 MVA
Shasta - Flanagan
Shasta - Cottonwood #1 & #2
Captain Jack (BPA)
Malin (BPA)
Malin - Round Mt. #1
Spring Creek - Keswick
J.F. Carr
Spring Creek
J.F. Carr - Keswick
Flanagan
(Shasta Lake)
100' R/W
Airport - Cottonwood
Airport
Whiskeytown
Flanagan - Keswick
KNAUF
TO KESWICK
115kV
Central
Valley
Keswick
TO KNUAF
TO REDDING
Keswick - Airport
Round Mountain
(PG & E)
Round Mt. - Cottonwood #1
Kes to Cw Taps
Captain Jack - Olinda
Keswick - Olinda
Cottonwood - Olinda
Cottonwood - Roseville
Folsom - Nimbus
Nimbus
Folsom
Olinda
(TANC/Western)
Cottonwood
(PG & E)
Olinda - Maxwell
Olinda - O'Banion
Orangevale
(SMUD)
Folsom - Roseville
Lake
(SMUD)
SPO
Roseville
Keswick - O'Banion
Sutter Powerplant
3-175 MVA
O'Banion
Fiddyment - Elverta
Roseville - Elverta
Roseville - Fiddyment
200' R/W
Fiddyment
(Roseville)
O'Banion - Sutter
O'Banion - Elverta
Elverta
(Western)
Elverta
(SMUD)
Natomas
(SMUD)
Maxwell
(TANC/Western)
Elverta - Hurley #1
Elverta - Hurley #2
200' R/W shared
with SMUD to
tower 18/2
Maxwell - Tracy
Hurley
(SMUD)
Banks
(Future)
Hurley - Tracy #1
Hurley - Tracy #2
Tracy - Banks
Tracy - Livermore
BBID
Tracy
Lawrence
Livermore
Herdlyn
(PG&E)
Tesla
(PG&E)
(1&2)
Contra Costa
(CCWD)
Tracy - Mt. House (1 & 2)
Westley (MID/TID)
(2)
Los Vaqueros
(CCWD)
Tracy - Vaqueros
ECCID
Tracy - CCWD
SYMBOL KEY
FACILITIES INCLUDED IN THE TRANSMISSION REVENUE REQUIREMENTS
FACILITIES NOT INCLUDED IN THE TRANSMISSION REVENUE REQUIREMENTS
POWERPLANT
INTERCONNECTION
2012