


Line Outage Requested By

WAPA Maintenance
WAPA Construction
Adjacent Reliability Entities

Outage Start Date

≥ 60 Days Out
Long Range Process (Page 2)


< 60 Days Out
Short Range Process (Page 3)

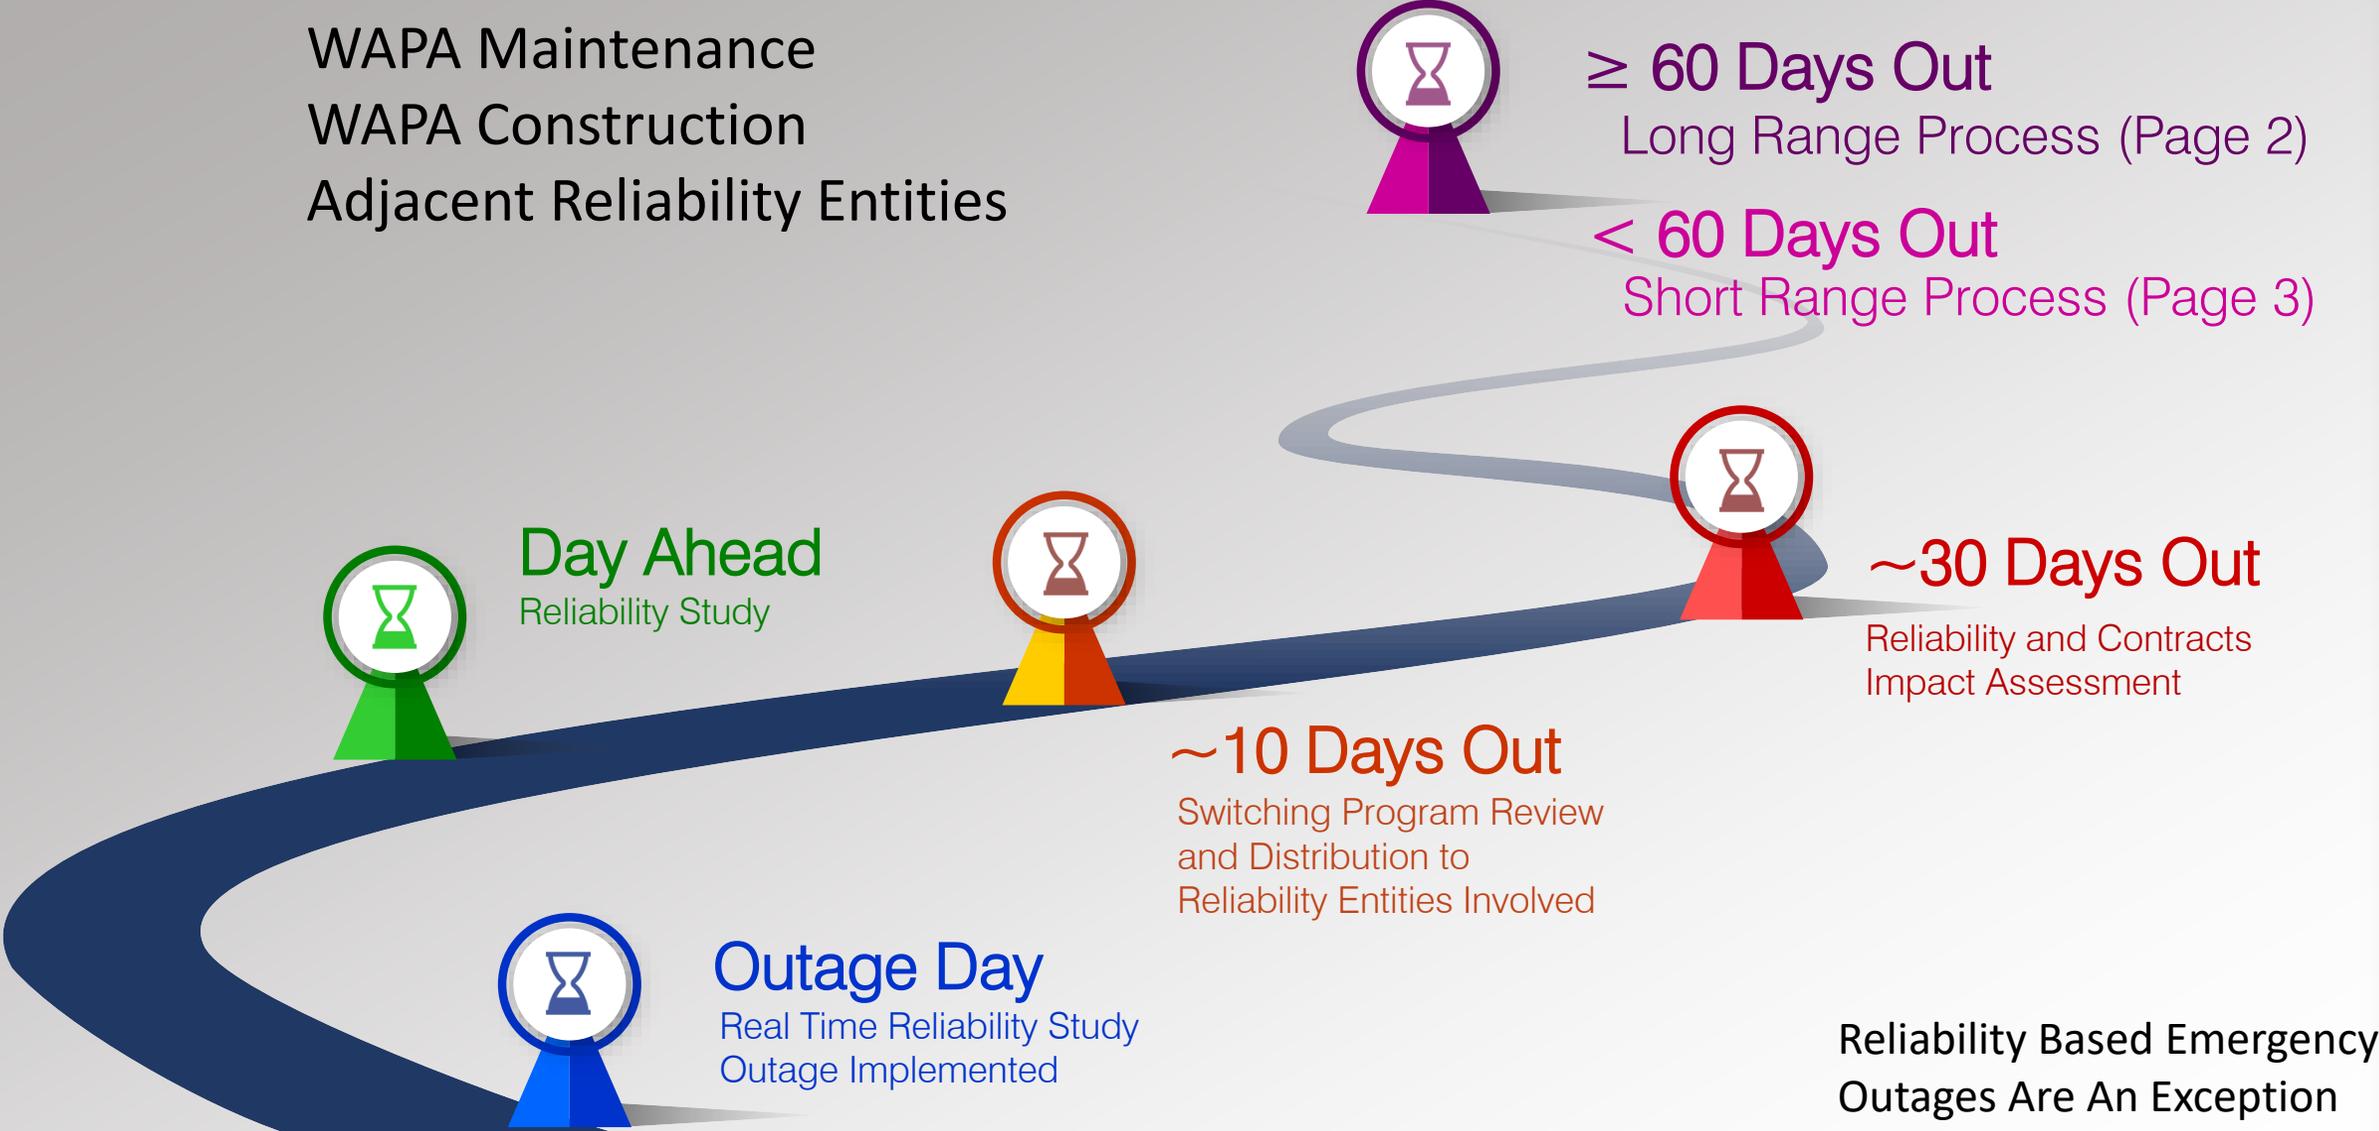

Reliability Based Emergency
Outages Are An Exception
To This Process

Long Range Outage Process

* Outage coordinators
OPS Engineering
Transmission Business Unit
Contracts
Construction
Lines / Subs
Scheduling

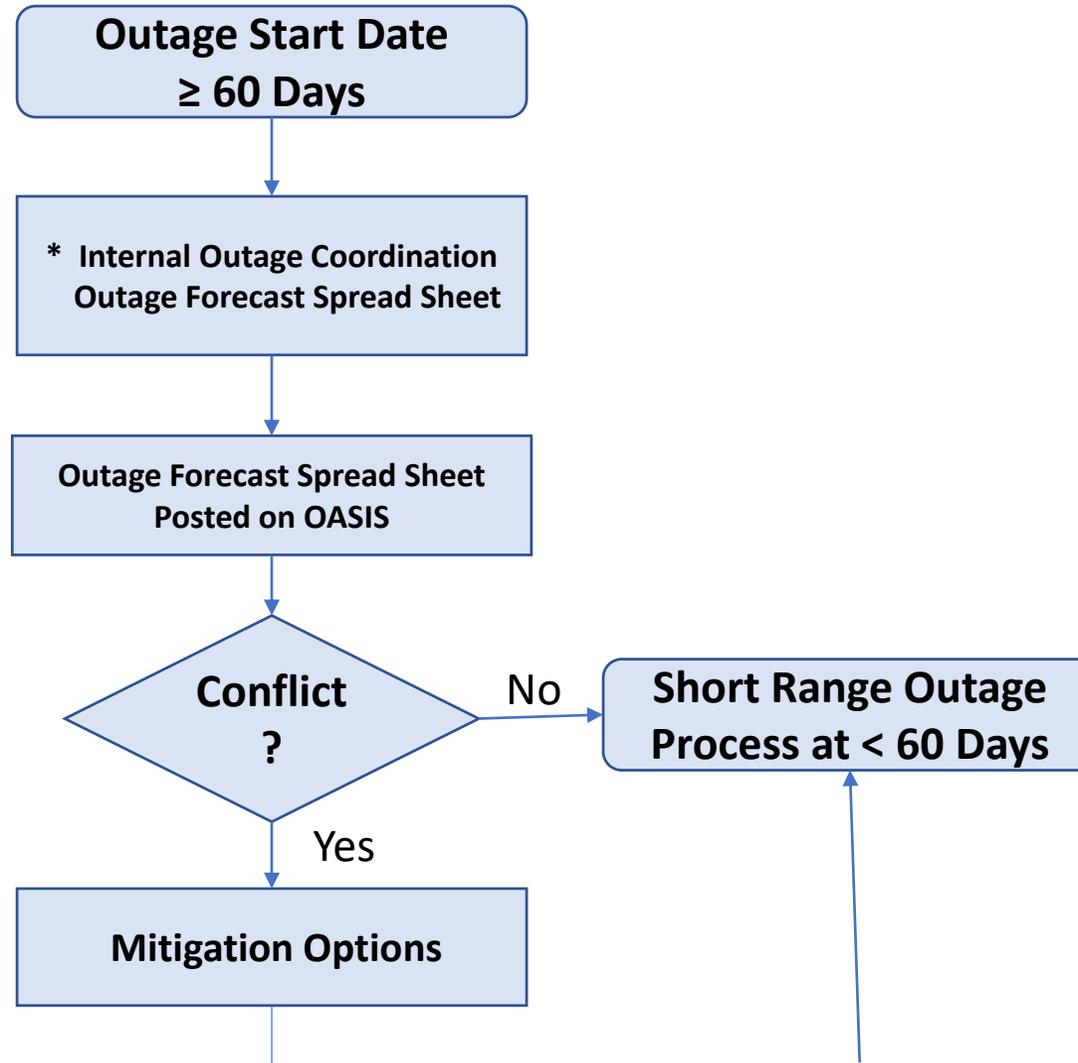

Short Range Outage Process

*FRP = Federal Resource Planner

